


1 RESERVOIR CROSS SECTION
 SA-6 SCALE: 1/4" = 1'-0"

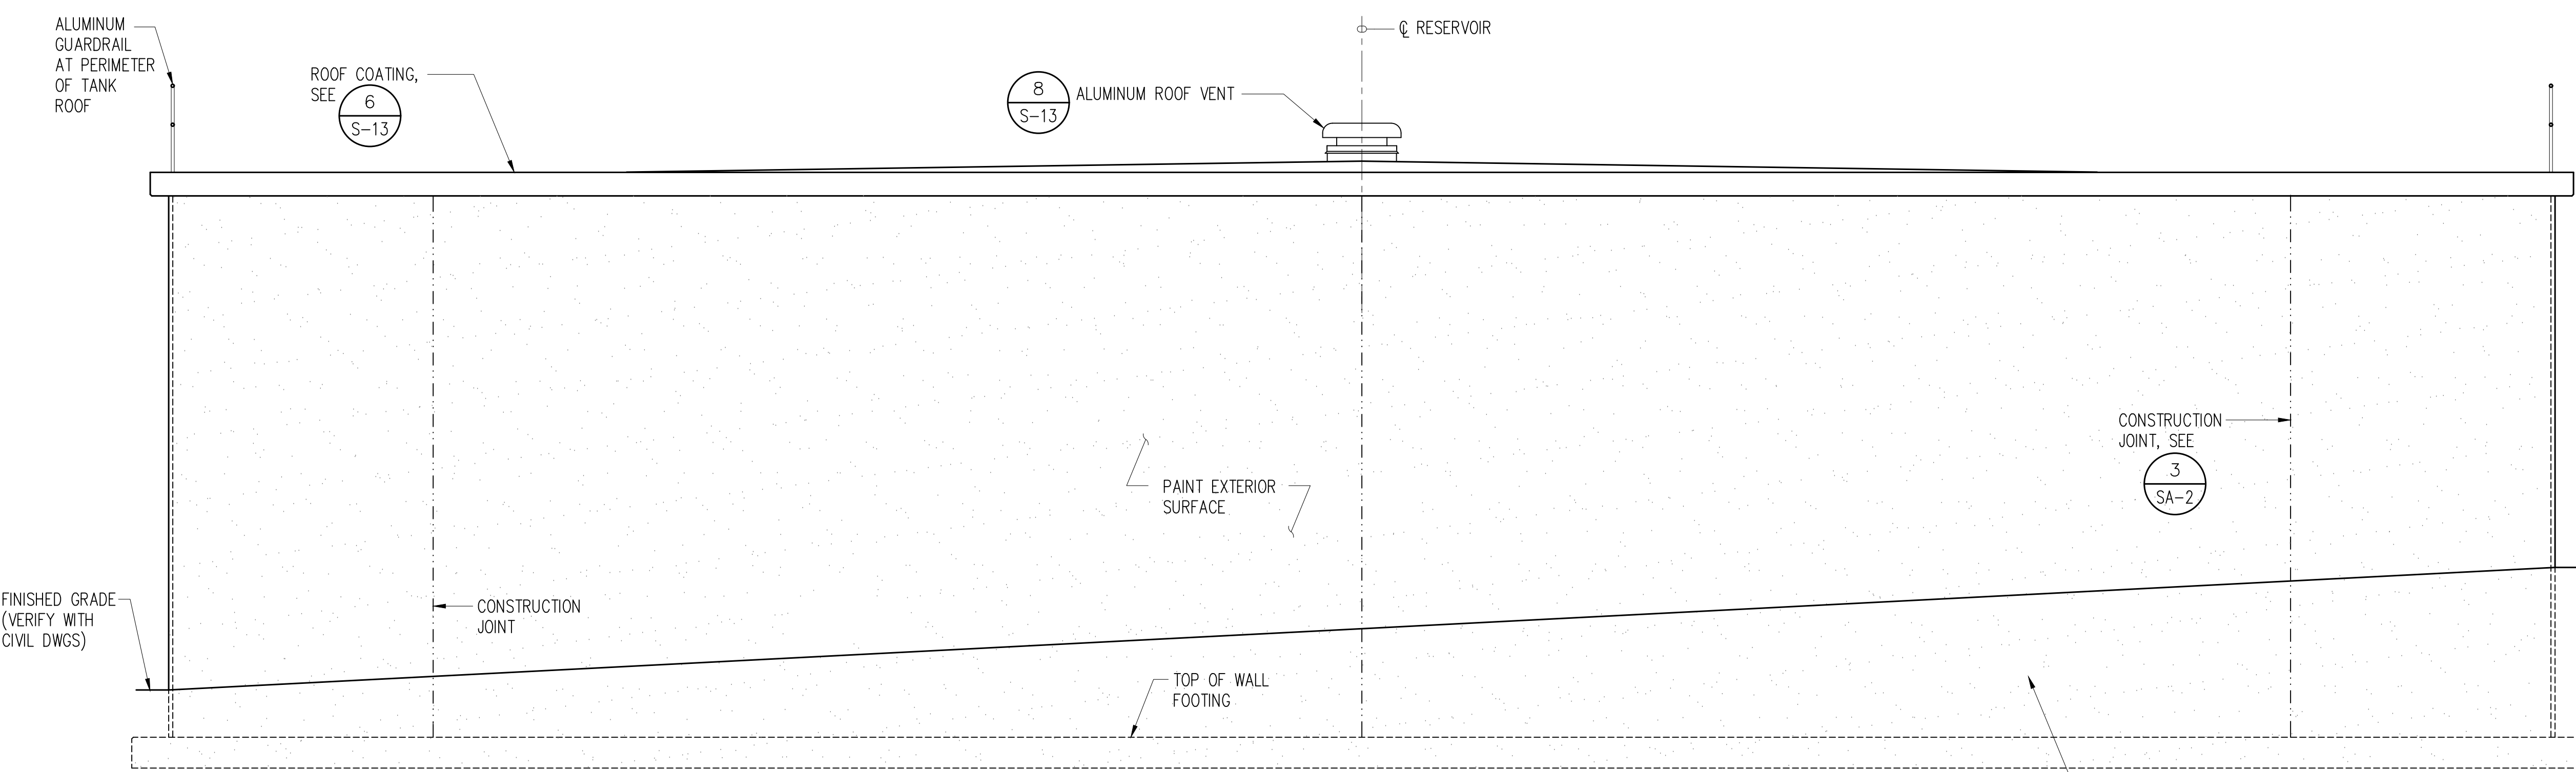

2 RESERVOIR ELEVATION
 SA-6 SCALE: 1/4" = 1'-0"

PAINTING NOTES:

A. EXTERIOR WALL SURFACE: KAUAI GREEN

- PRIME: ICI DEVCOE COATING 4030 TRU-GLAZE-WB WATERBORNE EPOXY PRIMER AT 200-270 SF/GAL (4.0-8.0 MILS WET; 2.0-4.0 MILS DFT)
- FINISH: (2 COATS) GLIDDEN FORTIS 350 WATERBORNE ACRYLIC LATEX SEMI-GLOSS FINISH AT 350-400 SF/GAL (4.0-4.6 MILS WET; 1.4-1.6 MILS DFT PER COAT.

B. BELOW GRADE EXTERIOR SURFACES: WATERPROOFING

- LIQUID APPLIED URETHANE COATING THAT FORMS AN ELASTOMERIC WATERPROOF MEMBRANE, SUCH AS "CIM 1000" BY C.I.M INDUSTRIES, INC. OR APPROVED EQUAL



<p>THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION</p> <p><i>Jerry S. Fujita</i> Signature EMP. 4/26</p>	QFB #4 REVISION DATE DESCRIPTION BY APPROVED 3/13/2026 Delete interior coating
	<p>CONSTRUCT KĪLAUEA 466' TANK, 1.0 MG</p> <p>WOUND RESERVOIR ELEVATION AND SECTION</p> <p>APPROVED: 02/02/2026 <small>DEPT. OF WATER, COUNTY OF KAUAI</small></p>
<p>SA-6</p>	
<p>KODANI & ASSOCIATES ENGINEERS, LLC <small>1811 E. KALANĪ, HAWAII 96766</small></p>	
DESIGNED BY: JF DRAWN BY: CADD DATE: 26 April 2024	SHEET 56 OF 65