
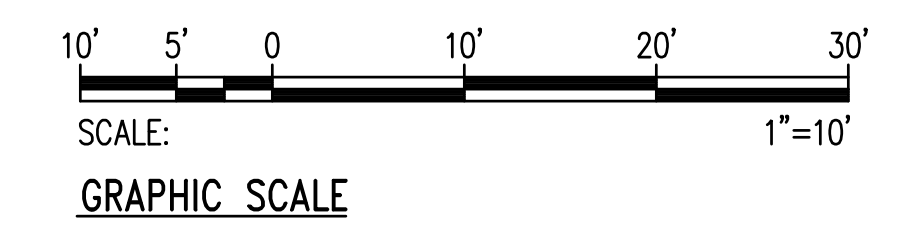


- NOTES:**
1. BREAK AND PATCH EXISTING KIUC HANDHOLE TO ACCOMMODATE INSTALLATION OF NEW CONDUIT PER KIUC REQUIREMENTS AND APPROVAL.
  2. 1" C, 2#12 CONTROLS.
  3. 6" SQ X 4" D JUNCTION BOX, NEMA 4XSS.  
QFB #6
  4. 1" C, 4#12 CONTROLS.
  5. EXPOSED CONDUITS MOUNTED ON THE SIDE OF THE TANK AND ON TANK ROOF SHALL BE PVC COATED RIGID STEEL, WITH STAINLESS STEEL UNISTRUT CHANNELS FOR MOUNTING ON TANK WALL OR ROOF, SPACED MINIMUM 4'-0" APART, OR AS REQUIRED BY NEC.

**1**  
**E-4** **ELECTRICAL SITE PLAN - NEW WORK**  
SCALE: 1"=10'



REVISION	DATE	DESCRIPTION	BY	APPROVED

**CONSTRUCT KILAUEA 466' TANK, 1.0MG**  
**ELECTRICAL SITE PLAN - NEW WORK**

	APPROVED:
	COUNTY ENGINEER: DEPT. PUBLIC WORKS, COUNTY OF KAUAI DATE: 2026.03.26 APPROVED:
This work was prepared by me or under my supervision and construction to this project will be under my observation.	MANAGER & CHIEF ENGINEER: DEPT. OF WATER, COUNTY OF KAUAI DATE: 2026.03.26 2026.03.26 24-30-26
<b>E-4</b>	
<b>KODANI AND ASSOCIATES ENGINEERS, LLC</b> LIHU'E, KAUAI, HAWAII, 96766	
DESIGNED BY: <b>BD</b>	DRAWN BY: <b>CAD</b>
DATE: <b>30-JAN-2026</b>	SHEET <b>60</b> OF <b>65</b> SHEETS